



Telephone:0484-2623576
email:-qcdlaluva@gmail.com

KERALA WATER AUTHORITY



QUALITY CONTROL DISTRICT LAB,ALUVA -683101

WATER TEST REPORT

ULR NO:TC121192500002149F

Report No: KWA/QCDL-ALY/S/1741/5/25

Report Issue Date: 06.06.2025

| | | |
|---|----------------------------|---|
| Customer Name &Address Mar Gregorius English Medium School CBSE N.Paraoor Temple Road | Date of Receipt of Payment | 24.05.25 |
| | Date of Sample received | 28.05.25 |
| | Sample given by | Clean City Manager, North Paravoor Municipality |
| | Sample Code | ALY/S/1741/5/25 |
| | Sample Name | Drinking Water |
| | Sample Condition | Good |
| | Source of Sample | Pipe Line |
| | Sample Quantity | 2 Litre |
| | Test performing dates : | From :05.06.25 to 06.06.25 |

| Sl.N | Characteristics | Unit | Test Method | Acceptable Limit as per IS 10500-2012 | Result |
|------|-----------------------------------|--------------|---|---------------------------------------|--------|
| 1 | Turbidity | NTU | IS 3025 (Part10)-2023 | 1.0 | 0.4 |
| 7 | pH at 25°C | - | IS 3025 (Part 11)-2022 | 6.5 to 8.5 | 7.01 |
| 3 | Total Hardness (as CaCO3) | mg/L | IS 3025 (Part21)-2009(Reaffirmed 2023) | 200 | 28 |
| 4 | Chloride (as Cl) | mg/L | IS 3025 (Part 32)-1988(Reaffirmed 2019) | 250 | 11.80 |
| 5 | Iron (as Fe) | mg/L | IS 3025 (Part 53)-2024 | 1 | 0.25 |
| 6 | Nitrate (as NO3) | mg/L | APHA 24rd Edition-4500-NO3 Method B(UV Spectrophotometric Screening Method) | 45 | 2.4 |
| 7 | Electrical conductivity at 25°- C | micromhos/cm | IS 3025 (Part 14)-2013(Reaffirmed 2019) | - | 62.00 |

Remarks:- DL : Detectable Limit
BDL : Below Detectable Limit

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

[Signature]
Analyzed By Technical Manager


Reviewed By Deputy Quality Manager

[Signature]
Authorized By Quality Manager

End of Report

| | |
|-----------------------|------------------------|
| KWA/QCDL/ALY/01-2020 | Issue Date: 04.10.2020 |
| Rev.No: 03 | Page 1 of 1 |
| Rev.Date : 02/06/2025 | |

QUALITY MANAGER
KWA, QUALITY CONTROL DISTRICT L
ERNAKULAM, ALUVA - 683 101

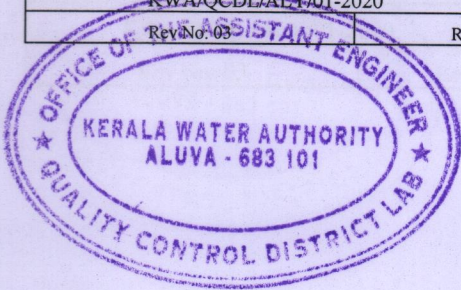



Telephone:0484-2623576
email:-qcdlaluva@gmail.com

KERALA WATER AUTHORITY
QUALITY CONTROL DISTRICT LAB,ALUVA -683101
WATER TEST-BACTERIOLOGY REPORT

Report No: ALY/B/7776

Report Issue Date: 06.06.2025


| Customer Name &Address Mar Gregorius English Medium School CBSE N.Paraoor Temple Road | | Date of Receipt of Payment | 24.05.25 | | |
|--|----------------|---------------------------------------|---|--------|--|
| | | Date of Sample received | 28.05.25 | | |
| | | Sample given by | Clean City Manager, North Paravoor Municipality | | |
| | | Sample Code | ALY/B/7776 | | |
| | | Sample Name | Drinking Water | | |
| | | Sample Condition | Good | | |
| | | Source of Sample | Pipe Line | | |
| | | Sample Quantity | 250ml | | |
| | | Test performing dates : | From :28.05.25 to 29.05.25 | | |
| Sl. No. | Parameter | Acceptable Limit as per IS 10500-2012 | Test Method | Result | |
| 1 | Total Coliform | Shall not be Detected/100ml | IS15185-2016 (Reaffirmed 2021) | Absent | |
| 2 | E-Coli | Shall not be Detected/100ml | IS15185-2016 (Reaffirmed 2021) | Absent | |

- NB:-1) The result stated above related only to the sample(s) submitted for testing by the customer .
2) The samples retain for 15 days from the end date of analysis
3) The test certificate shall not be reproduced except in full without the written approval of the Laboratory

Analyzed By
A. S. (DQM)

Authorized By Quality Manager
[Signature]

End of Report

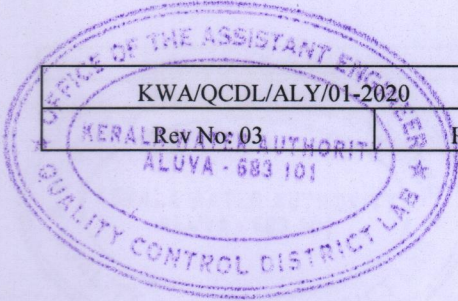

| | |
|----------------------|---|
| KWA/QCDL/ALY/01-2020 | Issue Date : 04.10.2020 |
| Rev No: 03 | Rev,Date : 02/06/2025 |
| Page 1 of 1 | QUALITY MANAGER QUALITY CONTROL DISTRICT LAB ERNAKULAM, ALUVA - 683 101 |